

Technical Data

UL181B-C (Mechanical Fasteners For Use With Flexible Air Ducts)

KSS Cable Tie is approved by UL181B-C to assure KSS Cable Tie's reliability in air ducts application. Installation instruction of cable ties shows below:

1. Roll back outer cover and slide inner liner over air duct connector.
2. Fix inner liner with cable tie.
3. Recover the outer cover.
4. Fix outer cover with another cable tie.

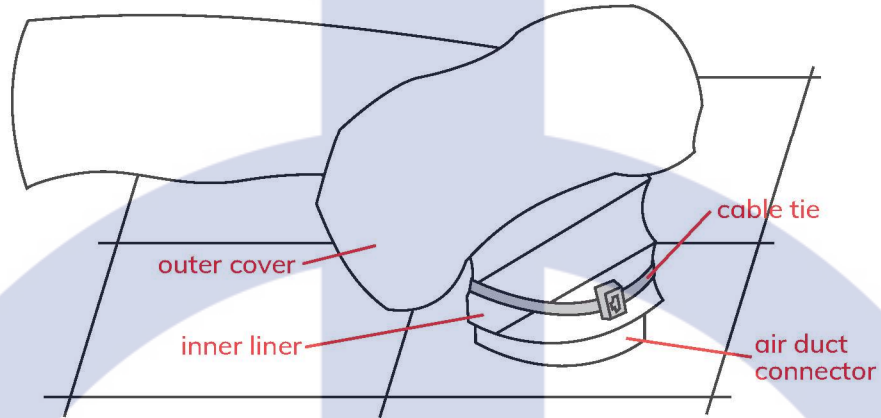


Figure1.

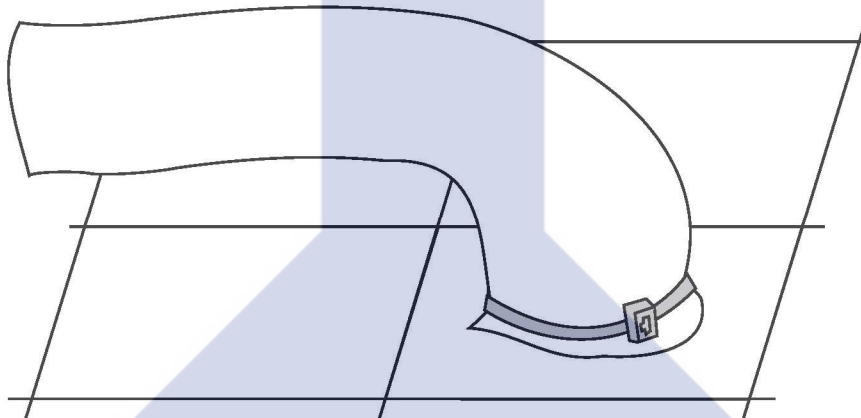


Figure2.

KSS